


Penta-Star Modulator

Installation Instructions

Installation:

- **Hardware Requirements:** Two independent momentary turn signal switches are required. The module will not work with latching type toggle switches.
- **Circuit Protection:** It is highly recommended that the turn signal circuit be protected with a 10 amp fuse or circuit breaker in the power supply lead (yellow wire).
- **Circuit Layout:** The adjacent wire code and schematic is typical for most installation. Use appropriate gauge wire.
- **Mounting:** It is recommended that the module be mounted in a location not subject to extreme heat conditions. It can be mounted with the included double sided adhesive tape or any other suitable means.

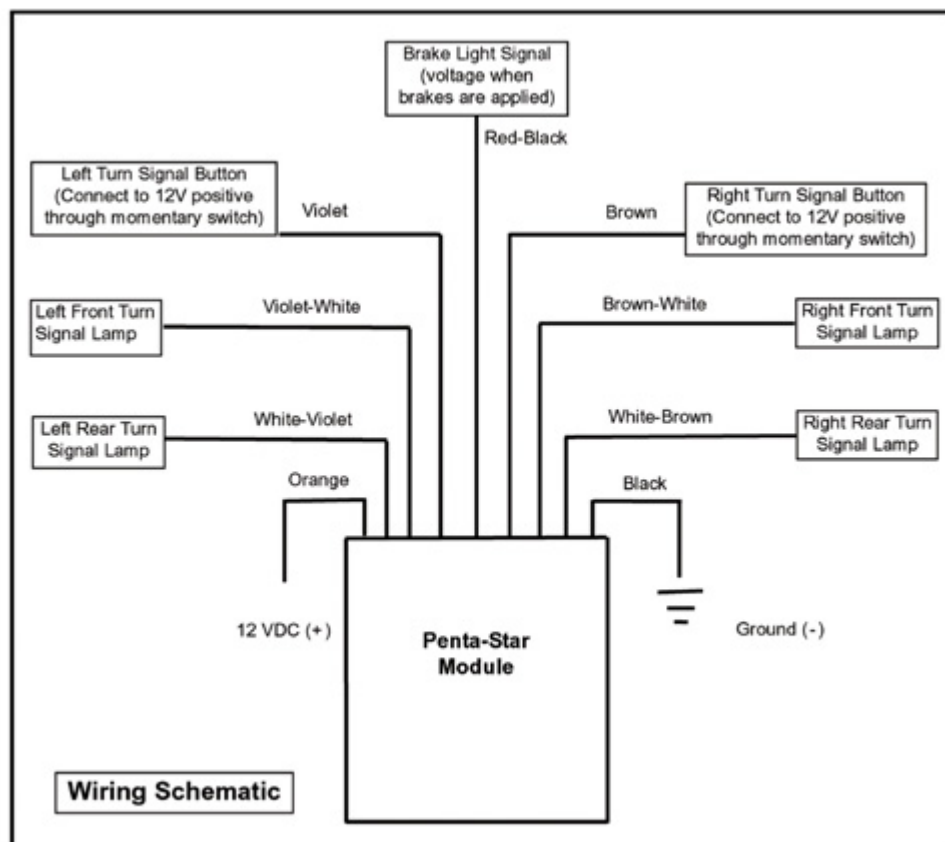

[Home](#) | [Search](#) | [Help](#) | [Contact](#) | [Cart & Checkout](#)

©2004 Signal Dynamics Corporation